

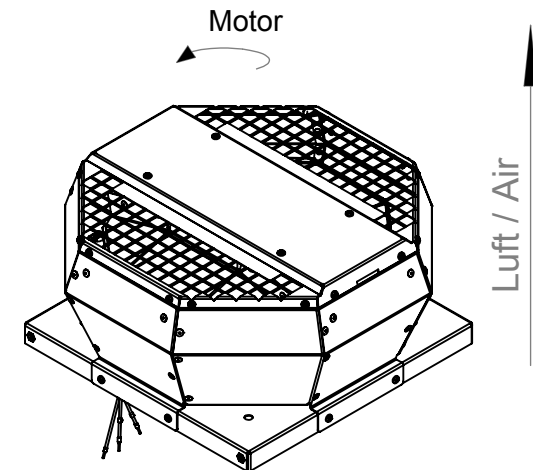
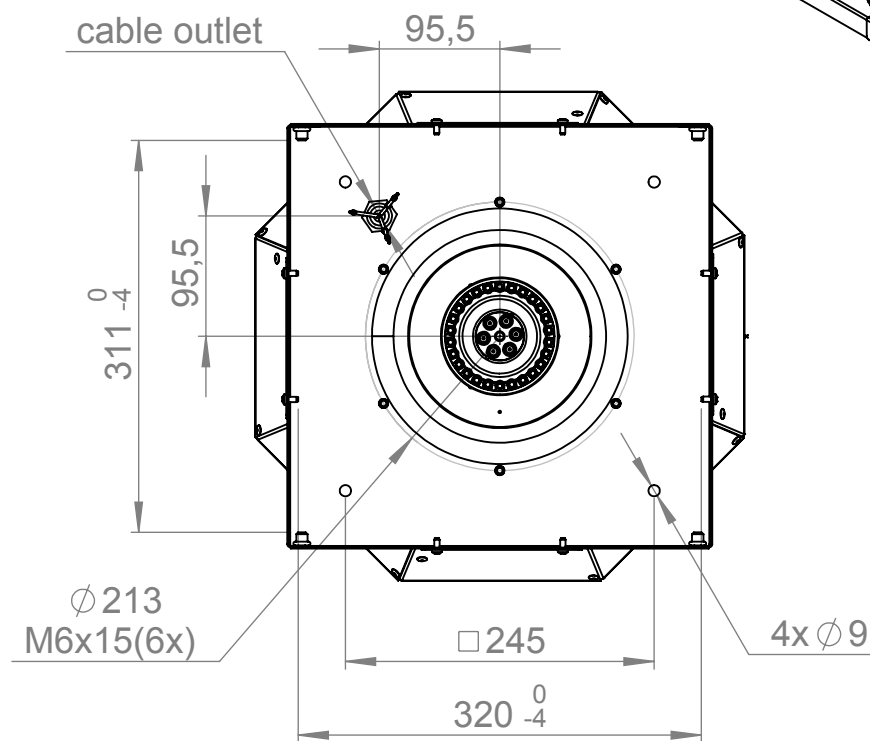


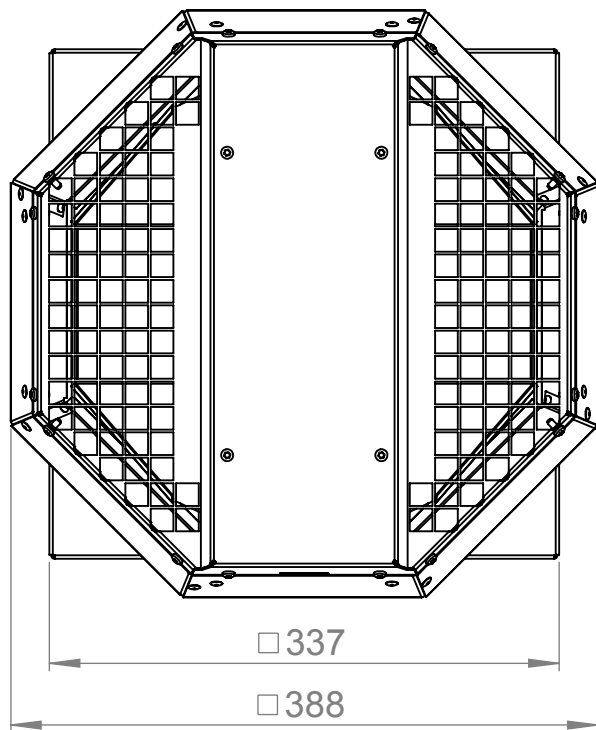

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg

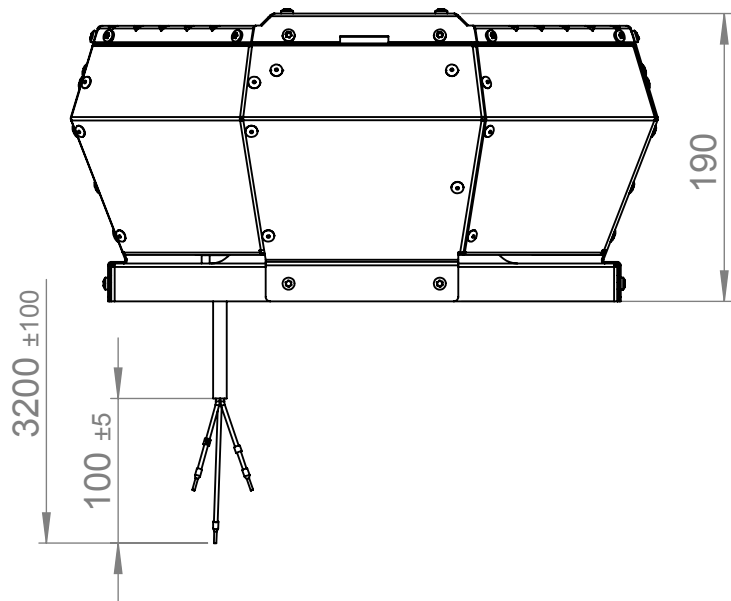

Protection Mark  
according to ISO 16016

Created d.hancu  
Drawn d.hancu  
Released v.brand  
Disabled

1:5 A4 mm

General tolerances  
DIN ISO 2768-c

**DVA250E430+**

**130440 00**