

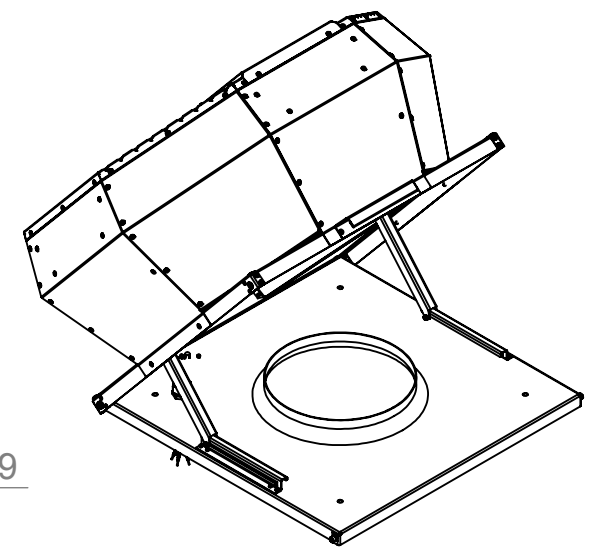


Cable outlet

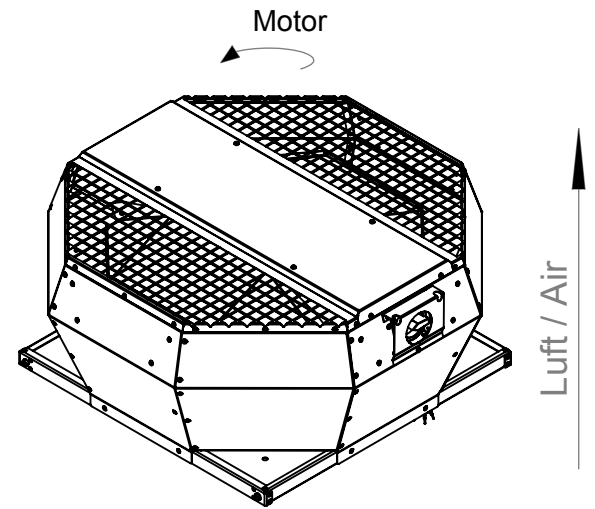

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

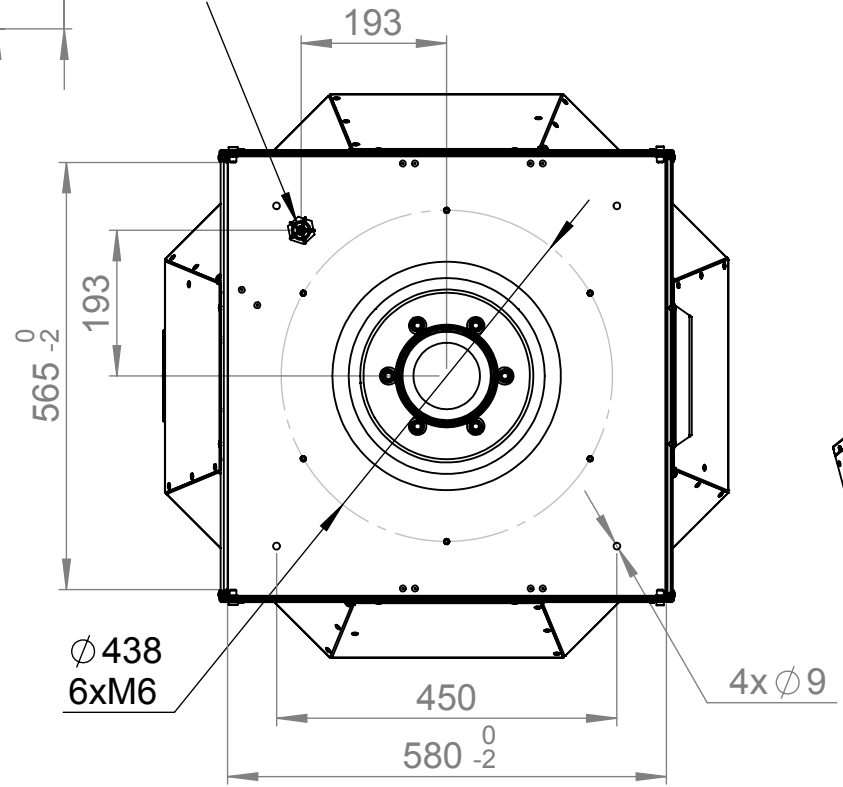

1:10 A4 mm

Protection Mark
according to ISO16016

General tolerances
DIN ISO 2768-c

DVA400E4P31

Drawn: a.ganea
Created: a.ganea
Changed:

30.03.2017
30.03.2017

139317 00